

APPLICATION GUIDE: STANDARD SPECIAL SIGNAGE

Lithonia Lighting offers special signage signs to suit many applications. The Signature and Quantum families highlighted below are illuminated with energy-efficient, long-life Light Emitting Diodes (LEDs).


WARRANTY — Complete warranty terms located at:

www.acuitybrands.com/CustomerResources/Terms_and_conditions.aspx

Note: Actual performance may differ as a result of end-user environment and application.

Specifications subject to change without notice.

| |
|----------------|
| Catalog Number |
| Notes |
| Type |

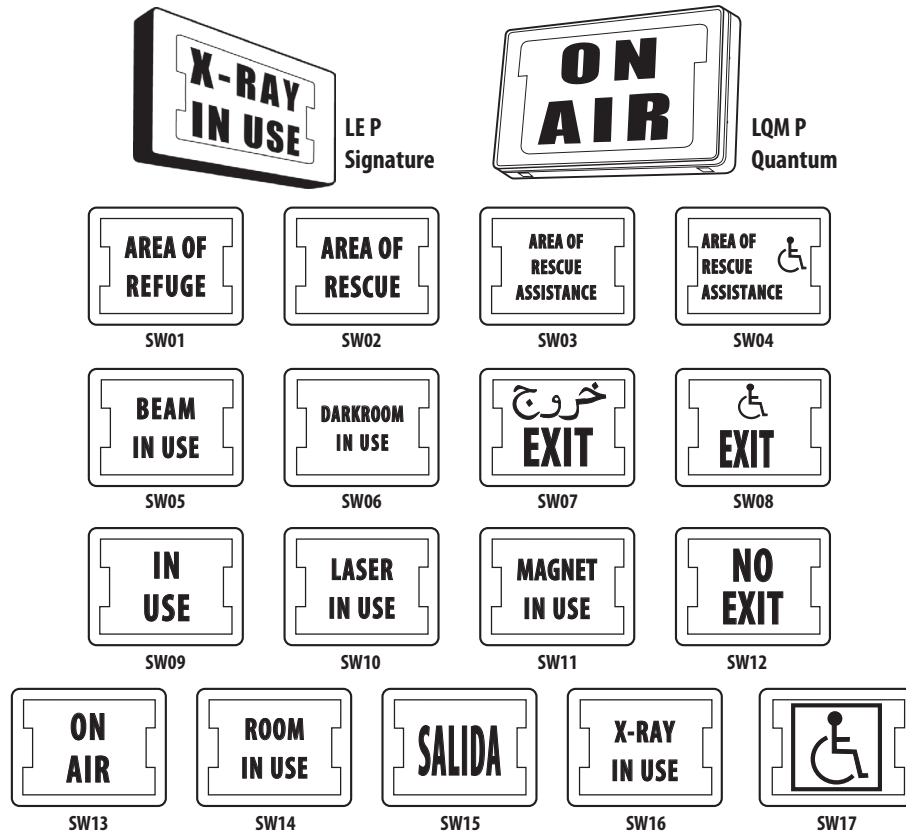

ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

Example: LE P 1 R EL N SW02

| Family | | Face type | Housing color | | Number of faces | | Letter color | Input voltage | | Operation | |
|-----------------|--------------------------------------------------------------|-----------|---------------|-----------------------------------------|-----------------|-----------------------------------------------------------------|--------------|-----------------------------------|------------------------------|------------------------|--|
| LE | Signature die-cast aluminum sign ¹ | P Panel | (blank) | Matte black, brushed aluminum face | 1 | Single face | R Red | 120/277 Dual voltage ⁵ | (blank) | AC only | |
| LQM | Quantum thermoplastic sign ^{2,3} | | W | White | 2 Double face | 3 Single face with extra faceplate and color panel ⁴ | G Green | | EL N | Nickel-cadmium battery | |
| Special wording | | | | | | | | | | | |
| SW01 | AREA OF REFUGE ⁶ | | SW05 | BEAM IN USE ^{6,7} | SW09 | IN USE ^{6,7} | | SW13 | ON AIR ^{6,7} | | |
| SW02 | AREA OF RESCUE ⁶ | | SW06 | DARK ROOM IN USE ^{6,7} | SW10 | LASER IN USE ^{6,7} | | SW14 | ROOM IN USE ^{6,7} | | |
| SW03 | AREA OF RESCUE ASSISTANCE ⁶ | | SW07 | EXIT Arabic/English ^{8,9} | SW11 | MAGNET IN USE ^{6,7} | | SW15 | SALIDA ⁹ | | |
| SW04 | AREA OF RESCUE ASSISTANCE with access pictogram ⁶ | | SW08 | EXIT with access pictogram ⁹ | SW12 | NO EXIT ⁹ | | SW16 | X-RAY IN USE ^{6,7} | | |
| | | | | | | | | SW17 | Handicap Symbol ⁶ | | |

Notes

- See spec sheet [LE-LRE](#) for complete specifications
- Only available in white housing. EL N operation only available in red letters for LQM family.
- See spec sheet [LQM](#) for complete specifications
- Only available with LQM family.

- Only required when ordering LQM family (ex: LQM P W 3 R 120/277 SW01).
- UL Listed as an electric sign.
- Not available with EL N operation.
- Only available in red letters.
- Not available with UL listing.

CUSTOM SIGNAGE

MAINTENANCE

All life safety equipment, including emergency lighting for path of egress must be maintained, serviced, and tested in accordance with all National Fire Protection Association (NFPA) and local codes. Failure to perform the required maintenance, service, or testing could jeopardize the safety of occupants and will void all warranties.