




4	21/07/16	PP	EDB UPDATE	DES: GPATEL
3	20/03/17	PP	SEISMIC UPDATE	DATE: 16/07/06
NO.	DATE	BY	REVISION	SCALE: NTS


EDBSG3Y0112KB

4.0 jwen 2021/07/16 13:56

d000186hb

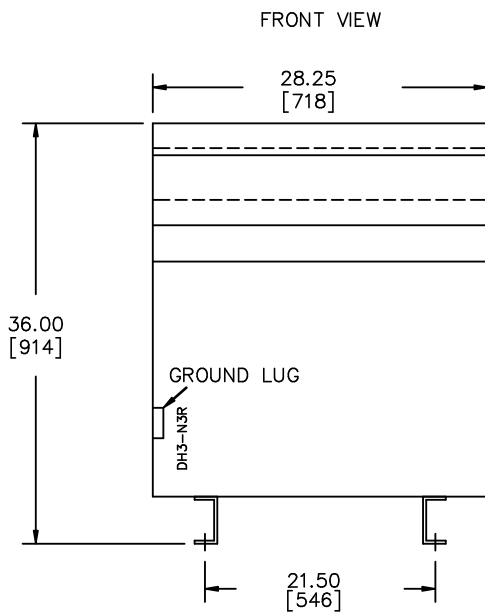

All Dimensions in inches[mm]

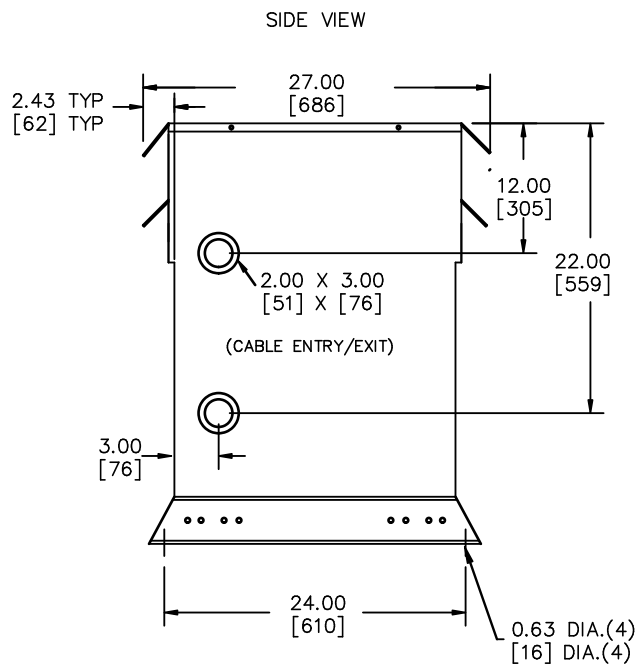



ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

LV TERMINAL DETAIL

XO TERMINAL DETAIL

MECHANICAL TYPE LUGS INCLUDED
SUITABLE FOR 250MCM-6 CU/AL
CONDUCTORS
1 CONDUCTOR PER PHASE

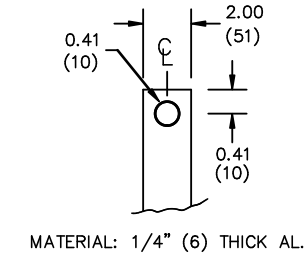

CUSTOMER NOTES:

- HV TERMINATED AT TOP FRONT
- LV TERMINATED AT BOTTOM FRONT
- XO TERMINATED AT BOTTOM FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER


4	21/07/16	PP	EDB UPDATE	DES: GPATEL
3	20/03/17	PP	SEISMIC UPDATE	DATE: 16/07/06
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSC3Y0112KB

4.0 jwen 2021/07/16 13:56

ENCLOSURE BOTTOM VIEW

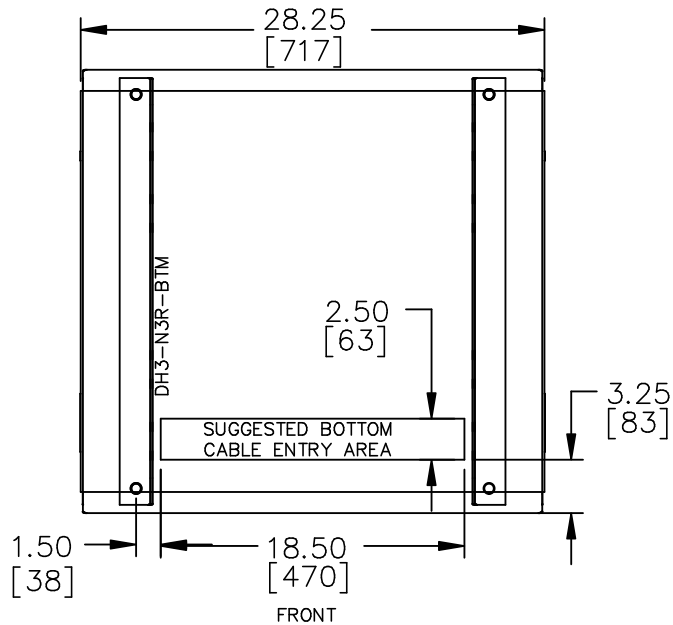

NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

4	21/07/16	PP	EDB UPDATE	DES: GPATEL
3	20/03/17	PP	SEISMIC UPDATE	DATE: 16/07/06
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDBSG3Y0112KB

4.0 JWB 2021/07/16 13:56