




1	21/07/13	PP	EDB UPDATE	DES: PPIICASSI
				DATE: 20/08/18
NO.	DATE	BY	REVISION	SCALE: NTS


EDB SG3Y0225BK0AHCOS

1.0 jwen 2021/07/13 17:29

[illegible]

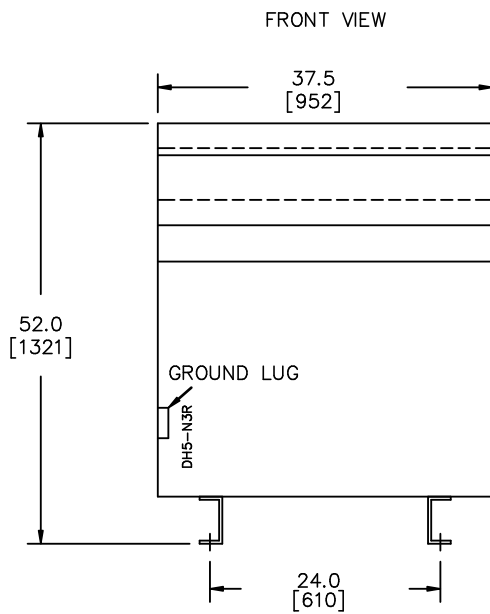


All Dimensions in inches[mm]

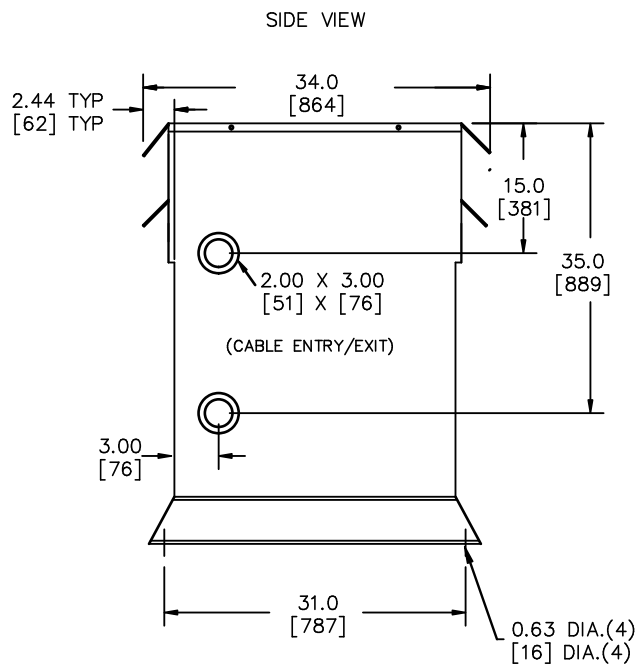


ENCLOSURE COLOR :ANSI 61 GREY – OUTDOOR

HV TERMINAL DETAIL

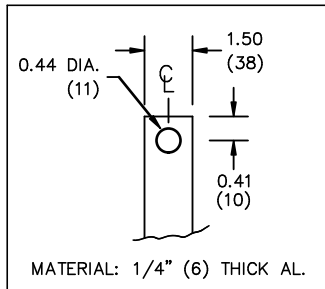

LV TERMINAL DETAIL

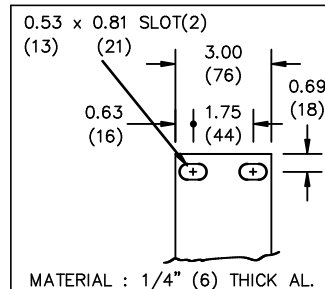

CUSTOMER NOTES:

- HV TERMINATED AT BOTTOM FRONT
- LV TERMINATED AT TOP FRONT



TITLE: 3PH DISTRIBUTION TRANSFORMER


1	21/07/13	PP	EDB UPDATE	DES: PPIACASSI
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 2 OF 3

EDBSC310225BK0AHIC05

1.0 jwen 2021/07/13 17:29

ENCLOSURE BOTTOM VIEW

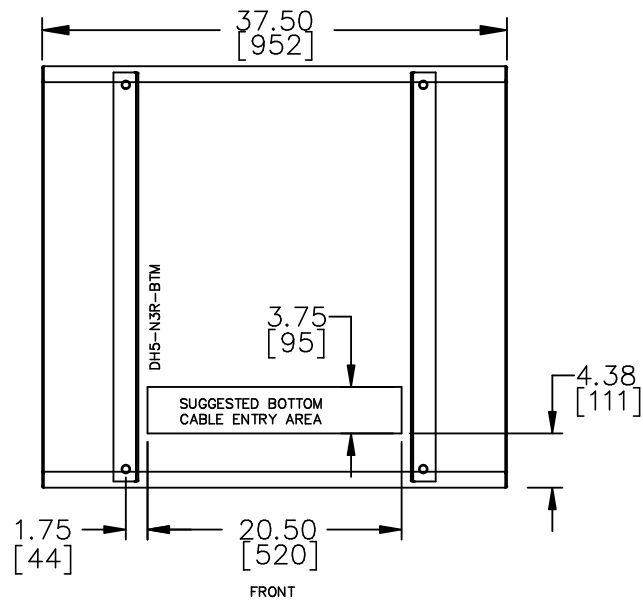

NOTE:
 WHEN BOTTOM CABLE ENTRY IS OPTED, THE SPACE USED FOR CONDUITS IN THE FRONT OF THE TRANSFORMER SHOULD NOT OBSTRUCT MORE THAN 50% OF THE FRONT AIR INTAKE AREA DEFINED BETWEEN THE BOTTOM PLATE AND THE SUPPORTING LEGS.
 SEE MANUAL FOR ADDITIONAL INFORMATION



TITLE: 3PH DISTRIBUTION TRANSFORMER
 ENCLOSURE BOTTOM VIEW

1	21/07/13	PP	EDB UPDATE	DES: PPICASSI
NO.	DATE	BY	REVISION	SCALE: NTS

SHEET 3 OF 3

EDB SC310225BK0AHICOS

1.0 jwen 2021/07/13 17:29